

LATROBE MUNICIPAL AUTHORITY

2022 CONSUMER CONFIDENCE REPORT

Este informe contiene información muy importante sobre su agua de beber. Tradúzcala o hable con alguien que lo entienda bien. (This report contains very important information about your drinking water: Translate it, or speak to someone who understands it.)

*Public Water Supply
ID#5650060
P.O. Box 88
Latrobe, Pa 15650
724-537-3378
www.LatrobeMA.com*

Annual Drinking Water Report

Explanation:

We at the Latrobe Municipal Authority are pleased to present this year's Annual Drinking Water Report. For your information, surface water from the H.A. Stewart Reservoir (A.K.A. Latrobe Reservoir) is processed at our Kingston Filtration Plant, and then delivered to our 9,500 industrial, commercial and residential customers. This report is designed to inform

Required CCR Statement Addressing Lead in Drinking Water

•••

"If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. LMA is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods and steps you can take to minimize exposure is available from the EPA Safe Drinking Water Hotline (1-800-426-4791) or at <http://www.epa.gov/safewater/lead>."

you about the quality of water that we provide to you every day. Our constant goal is to provide you with a safe and dependable supply of drinking water. We are pleased to report that in 2022 our drinking water continued to meet or exceed all federal and state requirements.

If you have any questions concerning this report, please contact me directly at 724-537-3378 or attend one of our board of directors' meetings normally held on the third Tuesday of each month at 5:00 PM at the Authority Office.

The Latrobe Municipal Authority


Terri A. Hauser,
Manager

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the EPA's Safe Drinking Water Hotline (1-800-426-4791).

The Latrobe Municipal Authority routinely monitors for contaminants in your drinking water according to federal and state laws. The Table at the bottom of this report shows the results of our most recent monitoring. The state allows us to monitor for some contaminants less than once per year because the concentration of these contaminants do not change frequently. Some of our data, though representative, are more than 1 year old. All sources of drinking water are subject to potential contamination by substances that are naturally occurring or man-made. These substances can be microbes, organic or inorganic chemicals, or radioactive materials. All drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. Keep in mind, the Environmental Protection Agency has set very stringent levels for these contaminants for your protection. More information about contaminants and potential health effects can be obtained by calling EPA's Safe Drinking Water Hotline at 1-800-426-4791.

In 2022, The Latrobe Municipal Authority located and repaired 79 leaks along 150 miles of main waterline.

A source water assessment of the H.A. Stewart Reservoir was completed in May 2002 for the Pennsylvania Department of Environmental Protection. According to the assessment report, the greatest potential threats to this water supply are an accidental release of contaminants along adjacent roadways and storm water runoff from agricultural areas within the watershed. Furthermore, abandoned strip mine runoff and malfunctioning septic systems may contribute to contamination. The overall risk of contamination is low. The report is available for review at the Authority office, as well as a complete report at the DEP regional office, and a summary report online at <http://www.depgreenport.state.pa.us/elibrary/getFolder?FolderID=4554>.

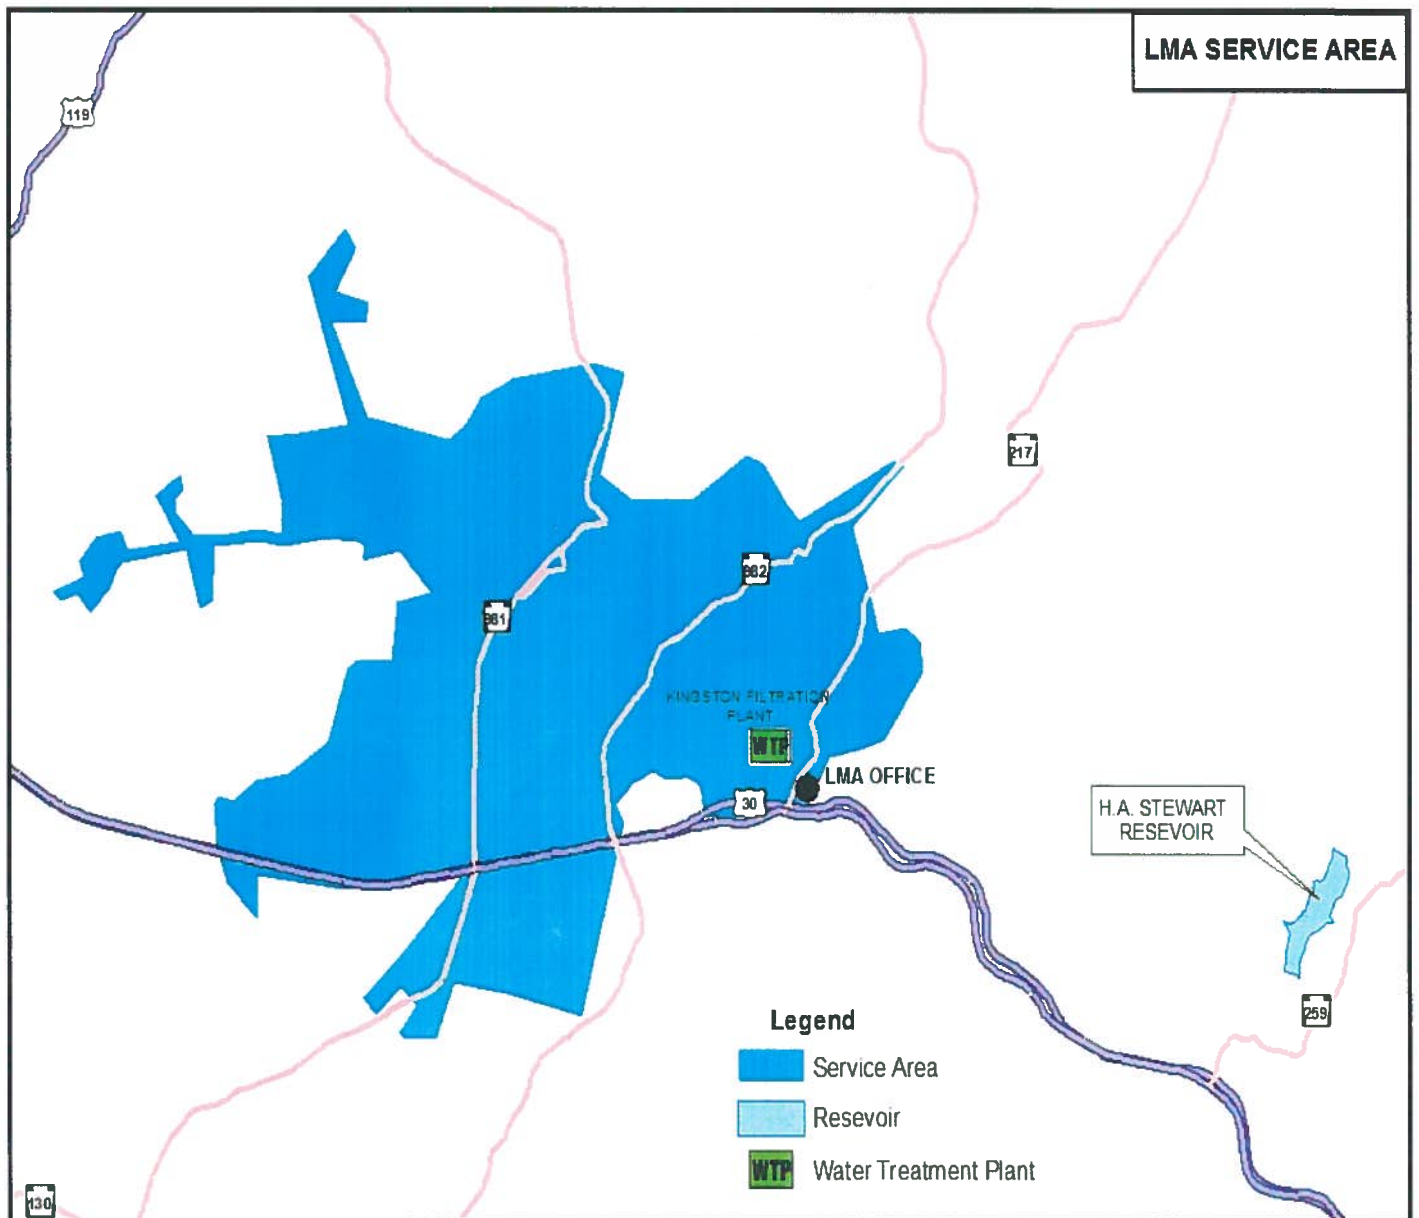

Microbial Contaminants:

Examples: viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife.

Inorganic Contaminants:

Examples: Salts and metals, which can be naturally occurring or result from urban storm water run-off, industrial or domestic wastewater discharges, oil and gas production, mining or farming.

Pesticides and Herbicides

May come from a variety of sources such as agriculture, urban storm runoff, and residential uses.

Organic Chemical Contaminants:

Examples: Synthetic and volatile organic chemicals, which are by-products of industrial processes and can also come from gas stations, urban storm water runoff and septic systems.

Radioactive Contaminants:

Can be naturally-occurring or be the result of oil and gas production and mining activities.

In order to ensure tap water is safe to drink, EPA and DEP prescribe regulations which limit the amount of certain contaminants in water provided by public water systems. FDA and DEP regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

In the following Table you may find some terms and abbreviations with which you might not be familiar with. To better help you understand these terms we have provided the following definitions:

Parts per million (ppm) or Milligrams per liter (mg/l):
One part per million corresponds to one minute in two years, or a single penny in \$10,000.

Picocuries per liter (pCi/L): a measure of radioactivity.

Parts per billion (ppb) or Micrograms per liter (ug/l):
One part per billion corresponds to one minute in 2,000 years or a single penny in \$10,000,000.

Nephelometric Turbidity Unit (NTU): A unit used to measure the clarity of water. Turbidity in excess of 5 NTU is noticeable to the average person.

Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which water systems must follow.

Treatment technique (TT): a required process intended to reduce the level of a contaminant in drinking water.

Maximum Contaminant Level (MCL): The highest level of a contaminant allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level (MRDL):
The highest level of a disinfectant allowed in drinking water. There is

convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Minimum Residual Disinfectant Level (MinRDL): The minimum level of residual disinfectant to control microbial contaminants.

In addition to the parameters listed in the table, The Latrobe Municipal Authority also sampled for other inorganic and organic contaminants. Laboratory analysis indicated that these contaminants were not present at detectable levels. Results of all monitoring are available at the Authority Office.

Chemical Contaminants								
Contaminant	MCL in CCR Units	MCLG	Level Detected	Range Of Detection	Units	Sample Date	Violation	Source of contamination
Barium	2	2	0.0260	-	ppm	Sep 2022	No	Discharge of drilling wastes and metal refineries; Erosion of Natural deposits
Haloacetic Acids (HAA5)	60	NA	27.74	11.2-38.4	ppb	Quarterly 2022	No	By-product of drinking water disinfection
Total Trihalomethanes (TTHM)	80	NA	36.47	17.1-60.4	ppb	Quarterly 2022	No	By-product of drinking water chlorination
Chlorine	MRDL= 4	MRDLG = 4	0.70	0.2 – 1.28	ppm	Monthly 2022	No	Water additive used to control microbes

Entry Point Disinfectant Residual							
Contaminant	Minimum Disinfection Residual	Lowest Level Detected	Range Of Detection	Units	Sample Date	Violation	Sources of Contamination
Chlorine	0.2	0.88	0.88-1.13	ppm	Monthly 2022	No	Water Additive used to control microbes

Lead and Copper							
Contaminant	Action Level (AL)	MCLG	90th % Value	Units	# Of All Sites Above AL of Total Sites	Violation	Sources Of Contamination
Lead (2022)	15	0	3.24	ppb	0	No	Corrosion of Household plumbing
Copper (2022)	1.3	1.3	0.0336	ppm	0	No	Corrosion of Household plumbing

Microbial (Related to E-coli)					
Contaminants	MCL	MCLG	Positive Sample(s)	Violation	Sources of Contamination
E.coli	Routine and repeat samples are total coliform-positive and either is E. Coli-positive or system fails to take repeat samples following E.coli-positive routine sample or system fails to analyze total coliform-positive repeat sample for E-coli.	0	0 Positive Samples in 2022	No	Human and Animal Fecal Waste

Turbidity						
Contaminant	MCL	MCLG	Level Detected	Sample Date	Violation	Source of Contamination
Turbidity	TT=1 NTU for a single measurement	0	0.14	03/06/2022	NO	Soil Runoff
	TT= At least 95% of monthly samples less than or equal to 0.3 NTU		100%	Monthly	NO	

Microbial Contaminant		
Trout Run		
Contaminant	Result (Oocysts/L)	Date Sampled
Cryptosporidium	0.00	12/5/2017
Cryptosporidium	0.00	11/7/2017
Cryptosporidium	0.00	10/3/2017
Cryptosporidium	0.00	9/5/2017
Cryptosporidium	0.00	8/9/2017
Cryptosporidium	0.00	7/12/2017
Cryptosporidium	0.00	6/6/2017
Cryptosporidium	0.00	5/30/2017
Cryptosporidium	*	4/21/2017
Cryptosporidium	0.00	3/7/2017
Cryptosporidium	0.00	2/7/2017
Cryptosporidium	0.00	1/3/2017

Microbial Contaminant		
Loyalhanna Creek		
Contaminant	Result (Oocysts/L)	Date Sampled
Cryptosporidium	0.00	12/5/2017
Cryptosporidium	0.087	11/7/2017
Cryptosporidium	0.00	10/3/2017
Cryptosporidium	0.00	9/5/2017
Cryptosporidium	0.00	8/9/2017
Cryptosporidium	0.00	7/12/2017
Cryptosporidium	0.087	6/6/2017
Cryptosporidium	0.00	5/30/2017
Cryptosporidium	*	4/21/2017
Cryptosporidium	0.00	3/7/2017
Cryptosporidium	0.00	2/7/2017
Cryptosporidium	0.00	1/3/2017

* Four samples were taken in April 2017. Results were not provided to the Latrobe Municipal Authority due to quality control issues at the contracted laboratory.

** All results are from raw water samples taken at the Trout Run and Loyalhanna Creek sources prior to treatment.

Note: The Latrobe Municipal Authority was not required to monitor for Cryptosporidium in 2022.



Tier 2 Public Notice

**FAILURE TO COMPLETE A LEVEL 2 ASSESSMENT
 (TRIGGERED BY TOTAL COLIFORM SAMPLES)**

(Note: Instructions are on pages 1 & 2; a fill-in-the-blank Public Notice (PN) template is on the third page.)

The public notice located on the third page of this document is applicable when there is a failure to perform a Level 2 assessment within 30 days of being triggered by a second Level 1 assessment within a rolling 12-month period.

Description of Violation

A system's failure to complete a Level 2 assessment within the required timeframe is a treatment technique violation and requires Tier 2 notification.

Community Delivery Requirements

Community water suppliers must provide within 30 days, a Tier 2 PN to **each customer** using one or more of the following forms of **direct** delivery:

- Hand delivery
- Postal mail
- Electronic mail
- Automatic telephone dialing systems
- Another form of direct delivery approved in writing by the Department of Environmental Protection (DEP)

Noncommunity Delivery Requirements

Noncommunity water suppliers must provide a Tier 2 PN within 30 days to consumers using one of the following methods:

- Posting in conspicuous locations
- Hand delivery
- Postal mail
- Electronic mail
- Another method reasonably designed to reach other persons served by the system if they can't be reached by the above-bulleted methods

Mandatory Language

Mandatory language on health effects must be included as written and is presented in this notice in ***italics***.

You must also include mandatory language provided in ***italics*** to encourage notice recipients to distribute the PN to others, where applicable.

Assessment Trigger

Explain why a Level 2 assessment was triggered by stating that total coliform bacteria were detected in the distribution system twice within a rolling 12-month period.

Corrective Action (What is being done?)

In your notice, describe corrective actions you are taking. You can use one of the following statements, if appropriate, or develop your own text:

- Although we did not meet our Level 2 assessment submission deadline, we have since submitted the assessment to the Pennsylvania Department of Environmental Protection on *[enter date assessment was submitted]*.
- Although we did not meet our Level 2 assessment submission deadline, we will be submitting our assessment to the Pennsylvania Department of Environmental Protection on October 3, 2022.

Repeat Notices

You must issue a repeat notice every three months for as long as the violation persists.

For repeat notices, you should state how long the violation has been ongoing and remind consumers of when you sent out any previous notices. If you are making progress in correcting the deficiency or achieving the required treatment, describe your progress. Alternatively, if funding or other issues are delaying your progress, let consumers know.

PN Certification

Send DEP a copy of each type of notice and the certification form (3930-FM-BSDW0076) to DEP within ten days after you issue the notices.

Template Form Field Instructions

When you place your cursor in the blank form fields in the following template, look at the bottom, left corner of your computer (just above the START button) for instructions on the information you should enter in that field. For example, if you place your cursor over the first blank form field in the template, the instructions will read "Insert system name."

FAILURE TO COMPLETE A LEVEL 2 ASSESSMENT

IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER

ESTE INFORME CONTIENE INFORMACIÓN IMPORTANTE ACERCA DE SU AGUA POTABLE. HAGA QUE ALGUIEN LO TRADUZCA PARA USTED, O HABLE CON ALGUIEN QUE LO ENTIENDA.

The Latrobe Municipal Authority recently violated a drinking water requirement. Although this is not an emergency, as our customers, you have a right to know what happened, what you should do, and what we did (are doing) to correct this situation.

Coliforms are bacteria that are naturally present in the environment and that are used as an indicator that a potential pathway exists through which contamination (including potentially harmful, waterborne pathogens) may enter the distribution system. We detected total coliform bacteria twice within a rolling 12-month period in our distribution system.

As a result, we were required to conduct a detailed Level 2 assessment of our system within 30 days. A Level 2 assessment is a detailed study of the water system treatment and distribution to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system. *We failed to conduct the required Level 2 assessment* within 30 days, and have therefore violated a drinking water requirement.

What should I do?

- There is nothing you need to do. You do not need to boil your water or take other corrective actions. However, if you have specific health concerns, consult your doctor.
- If you have a severely compromised immune system, have an infant, are pregnant, or are elderly, you may be at increased risk and should seek advice from your health care providers about drinking this water.

What does this mean?

This is not an emergency. If it had been, you would have been notified within 24 hours.

Failure to conduct a timely assessment to identify the sanitary defect that triggered the assessment has the potential to prolong the risk of fecal contamination of our distribution system water. While we have not detected any evidence of fecal contamination in our distribution system, we are committed to correcting the deficiency to eliminate the potential threat of contamination. *Inadequately treated water may contain disease-causing organisms. These organisms include bacteria, viruses, and parasites which can cause symptoms such as nausea, cramps, diarrhea, and associated headaches.*

These symptoms, however, are not caused only by organisms in drinking water, but also by other factors. If you experience any of these symptoms and they persist, you may want to seek medical advice.

What is being done?

Although we did not meet our Level II assessment submission deadline, we have since submitted the assessment to the Pennsylvania Department of Environmental Protection on October 3, 2022.

We anticipate resolving the problem within _____ (or the problem was resolved on July 15, 2022).

For more information, please contact: Terri Hauser, Manager at (724)537-3378.

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

This notice is being sent to you by the Latrobe Municipal Authority.

PWS ID #: 5650060

Date distributed: September 30, 2022